



GOVERNMENT OF THE VIRGIN ISLANDS OF THE UNITED STATES

-----0-----

DEPARTMENT OF PLANNING AND NATURAL RESOURCES

4611 Tutu Park Mall
Suite 300
St. Thomas, VI 00802
(340) 774-3320

45 Mars Hill, Frederiksted
St. Croix, VI 00840
(340) 773-1082
dpr.vi.gov



Office of the Commissioner

January 17, 2025

PUBLIC NOTICE

Commissioner Jean-Pierre L. Oriol of the Department of Planning and Natural Resources informs the public that the following St. Thomas Coastal Zone Management (CZM) Committee Meeting is scheduled for **Tuesday, January 21, 2025, at 4:00 pm**. This meeting will be held via the video conferencing platform ZOOM.

The agenda is as follows:

Decision Meetings (public testimony will not be heard)


Major Coastal Zone Management Permit No. CZMJLW0002-24... er US, LLC. The proposed project is the installation of an armor... cable to improve capacity and connectivity. This will in... ater cable system over several segments; 23 kilor... to Magen's Bay, St Thomas. The cable will... and connect AT&T of the Virgins... conduit.

Major Coastal Zone... the project proposes to... as, and to install 10 mo... will be 53' in length... ating lines to avoid impact... avoid benthic resources and 10... restaurant patrons. The proposed project... of the island of St. Thomas.

Dec... consistency Determination, CZM0027-24- Swan Annex Corre... ed project consists of demolition of the existing Swan Annex facility... three adjoining lots and building a new correctional facility. The location... is Subbase 104, 105, 106, 107, 108, 109 Southside Quarter (Estate Nisky) St... as, Virgin Islands.

Public Hearing (testimony will be heard)

Public Hearing for Federal Consistency Determination, CZM0032-23, has been submitted by the Virgin Islands Water & Power Authority (VIWAPA). The project is proposing to install of underground ducts with manholes, pad-mount transformers, and other underground devices to replace existing overhead distribution within Charlotte Amalie on

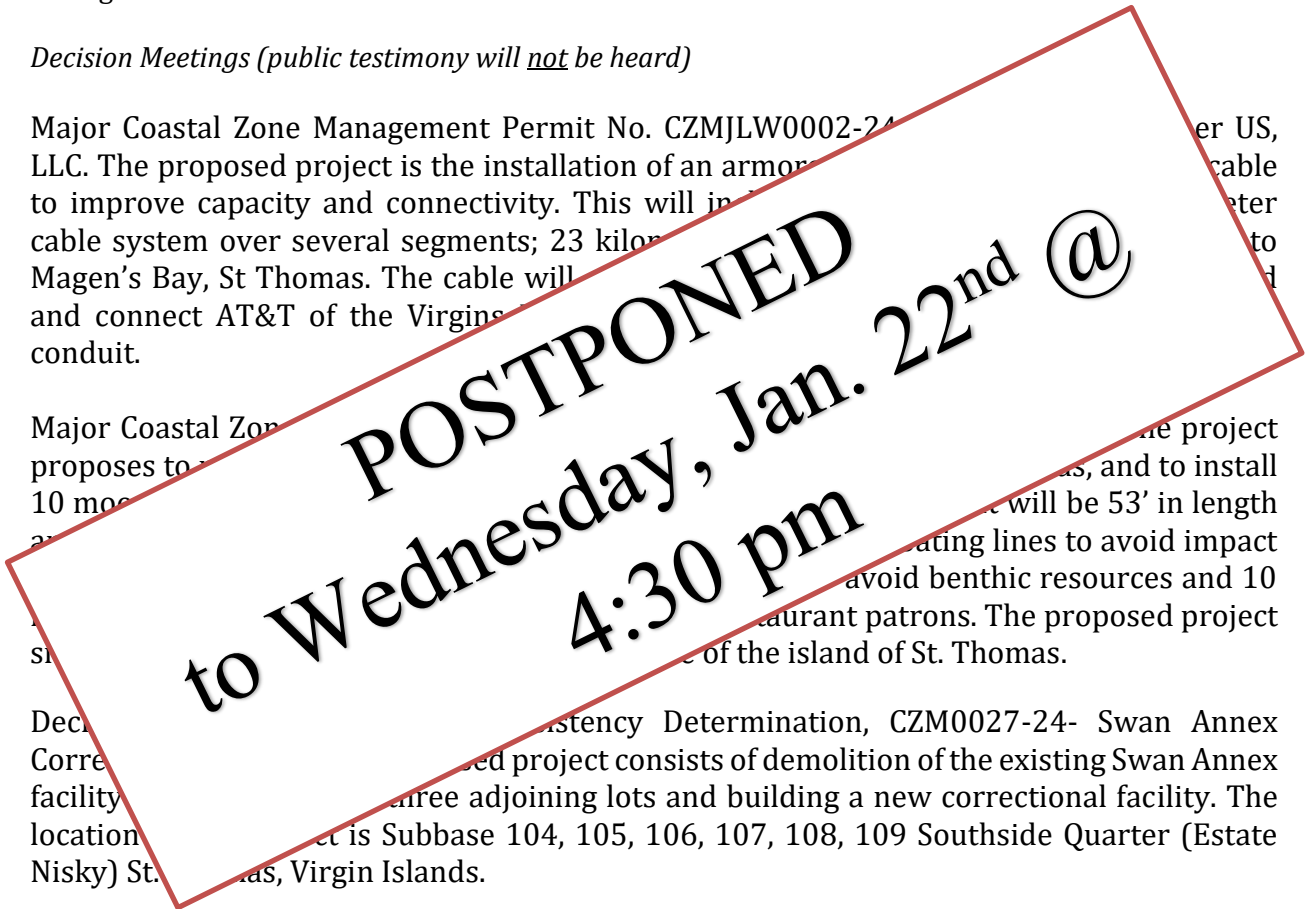

Feeder 9A. The underground ducts will replace overhead distribution lines along Airport Road (Route 302), throughout Crown Bay (Route 304) with branches to the Container Port and Tropical Shipping and along Harwood Highway/Kronprindsens Gade (Route 308) to the Market and Guttets Gade. The project will be done in 3 phases, and a portion of the project includes installation into existing conduits (Phase 1), but will include installation of new duct banks, transformers, sectionalizing cabinets, electric handholes, communications handholes, and electrical manholes.

The following information should be used to participate in the meeting:

ZOOM

Meeting ID: 854 3783 1820

Passcode: 772009

Jean-Pierre L. Oriol
Commissioner

Copy: Jamal Nielsen, Media Relations Coordinator