

HYDROLOGY STUDY REPORT

PROJECT SITE:

**V.I. FIRE & EMERGENCY MEDICAL SERVICES (VIFEMS)
GEORGE SCOTT FIRE STATION
PLOT 390 ESTATE ANNA'S RETREAT, NEW QUARTER
CHARLOTTE AMALIE, ST. THOMAS, USVI 00802**



PREPARED BY:


BUILDTec
7-1 BONNE ESPERANCE
P.O. BOX 8269
CHRISTIANSTED, ST. CROIX USVI 00823

TABLE OF CONTENTS

INTRODUCTION.....	3
SOILS CLASSIFICATION	3
CURVE NUMBER (CN) CLASSIFICATION.....	4
BASIN CHARACTERISTICS	6
TIME OF CONCENTRATION (T_c)	7
RUNOFF (Q) AND STORAGE VOLUME (V)	10
CONCLUSION.....	13
APPENDICES	14

INTRODUCTION

This site was previously developed and has a considerable amount of development that currently exist. The proposed improvements primarily encompass the replacement of the existing 4,700 square feet antiquated fire station building with a new expanded state-of-the-art facility measuring approximately 8,240 gross square footage. The new facility will be constructed within the exact same footprint of the existing facility.

The disturbed area is only 0.59 acres which is less than the 1-acre mandated threshold for a required hydrology study. Nonetheless, a hydrology study has been undertaken to ascertain the impacts of the proposed improvements. This hydrology study will focus on a pre-development vs. a post-development analysis.

SOILS CLASSIFICATION


For Curve Number (CN) determination, there are four (4) main types of Hydrologic Soils Classification which are as follows:

Group A – Soils that have low runoff potential when thoroughly wet. These soils typically have less than 10% clays and more than 90% sand or gravel.

Group B – Soils that have moderately low runoff potential when thoroughly wet. These soils typically have between 10% - 20% clays and 50% - 90% sand.

Group C – Soils that have moderately high runoff potential when thoroughly wet. These soils typically have between 20% - 40% clays and less than 50% sand.

Group D – Soils that have high runoff potential when thoroughly wet. These soils typically have greater than 40% clays and less than 50% sand.

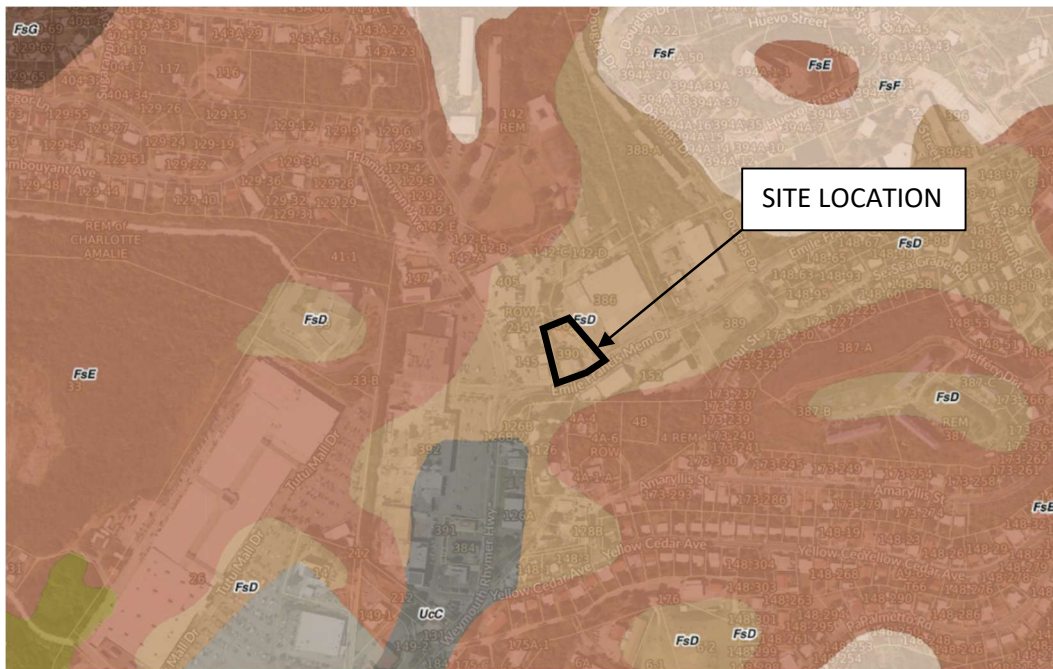

St. Croix Hydrologic Soils Classification (Source: <https://usvi.mapgeo.io>)

Based on the above, the Hydrologic Soils Classification for the Site is **Group D**. This soil classification type is synonymous with Group D in Table 3.6 below.

CURVE NUMBER (CN) CLASSIFICATION

The curve number classification is determined based on land use type and hydrologic soil type. The table below indicates CN values for various land uses and hydrologic soil types.

Table 3-6. Typical Curve Number Values for Urban Areas (SCS 1986)

Cover description		Curve numbers for hydrologic soil group			
Cover type and hydrologic condition	Average percent impervious area ^{1/2}	A	B	C	D
<i>Fully developed urban areas (vegetation established)</i>					
<i>Open space (lawns, parks, golf courses, cemeteries, etc.) ^{3/4}</i>					
Poor condition (grass cover < 50%)		68	79	86	89
Fair condition (grass cover 50% to 75%)		49	69	79	84
Good condition (grass cover > 75%)		39	61	74	80
<i>Impervious areas:</i>					
Paved parking lots, roofs, driveways, etc. (excluding right-of-way)		98	98	98	98
<i>Streets and roads:</i>					
Paved; curbs and storm sewers (excluding right-of-way)		98	98	98	98
Paved; open ditches (including right-of-way)		83	89	92	93
Gravel (including right-of-way)		76	85	89	91
Dirt (including right-of-way)		72	82	87	89
<i>Western desert urban areas:</i>					
Natural desert landscaping (pervious areas only) ^{4/5}		63	77	85	88
Artificial desert landscaping (impervious weed barrier, desert shrub with 1- to 2-inch sand or gravel mulch and basin borders)		96	96	96	96
<i>Urban districts:</i>					
Commercial and business	85	89	92	94	95
Industrial	72	81	88	91	93
<i>Residential districts by average lot size:</i>					
1/8 acre or less (town houses)	65	77	85	90	92
1/4 acre	38	61	75	83	87
1/3 acre	30	57	72	81	86
1/2 acre	25	54	70	80	85
1 acre	20	51	68	79	84
2 acres	12	46	65	77	82
<i>Developing urban areas</i>					
<i>Newly graded areas (pervious areas only, no vegetation) ^{5/6}</i>					
		77	86	91	94
<i>Idle lands (CN's are determined using cover types similar to those in table 2-2c).</i>					

¹ Average runoff condition, and $I_a = 0.28$.

² The average percent impervious area shown was used to develop the composite CN's. Other assumptions are as follows: impervious areas are directly connected to the drainage system, impervious areas have a CN of 98, and pervious areas are considered equivalent to open space in good hydrologic condition. CN's for other combinations of conditions may be computed using figure 2-3 or 2-4.

³ CN's shown are equivalent to those of pasture. Composite CN's may be computed for other combinations of open space cover type.

⁴ Composite CN's for natural desert landscaping should be computed using figures 2-3 or 2-4 based on the impervious area percentage (CN = 98) and the pervious area CN. The pervious area CN's are assumed equivalent to desert shrub in poor hydrologic condition.

⁵ Composite CN's to use for the design of temporary measures during grading and construction should be computed using figure 2-3 or 2-4 based on the degree of development (impervious area percentage) and the CN's for the newly graded pervious areas.

Based on the above, the site falls into two (2) distinct classifications listed as follows:

Poor condition (grass cover < 50%) – this accounts for the grass cover within the property.

Paved parking lots, roofs and driveways, etc. (excluding right-of-way) – this accounts for the paved surfaces and buildings within the property.

BASIN CHARACTERISTICS

The disturbed area of the site is approximately 0.59 acres broken down into two (2) major ground cover types. The table below shows the breakdown along with a Weighted Curve Number for each category and ultimately for the entire site.

➤ PRE-DEVELOPMENT

TABLE 1 - PRE-DEVELOPMENT BASIN CHARACTERISTICS			
DESCRIPTION	AREA	UNITS	WEIGHTED CURVE NUMBER (CN)
BUILDINGS	0.14	AC	98
SIDEWALK	0.007	AC	98
GRASS COVER	0.193	AC	89
CONCRETE PAVEMENT	0.25	AC	98

TOTAL AREA	0.59	AC
------------	------	----

WEIGHTED CN VALUE	95
-------------------	----

➤ POST-DEVELOPMENT

TABLE 2 - POST-DEVELOPMENT BASIN CHARACTERISTICS			
DESCRIPTION	AREA	UNITS	WEIGHTED CURVE NUMBER (CN)
BUILDINGS	0.23	AC	98
SIDEWALK	0.007	AC	98
CONCRETE PAVEMENT	0.20	AC	98
GRASS COVER	0.15	AC	89

TOTAL AREA	0.59	AC
------------	------	----

WEIGHTED CN VALUE	96
-------------------	----


TIME OF CONCENTRATION (T_c)

The time of concentration is necessary to estimate peak discharge and is dependent upon the watershed characteristics. To accurately determine T_c , the hydraulics of each part of the flow path must be considered separately.

➤ PRE-DEVELOPMENT

In the pre-development, the site has one distinct flow path, which is overland flow as follows:

- A-B (Overland Flow) – 218 ft. travel distance @ average slope of 7.8%

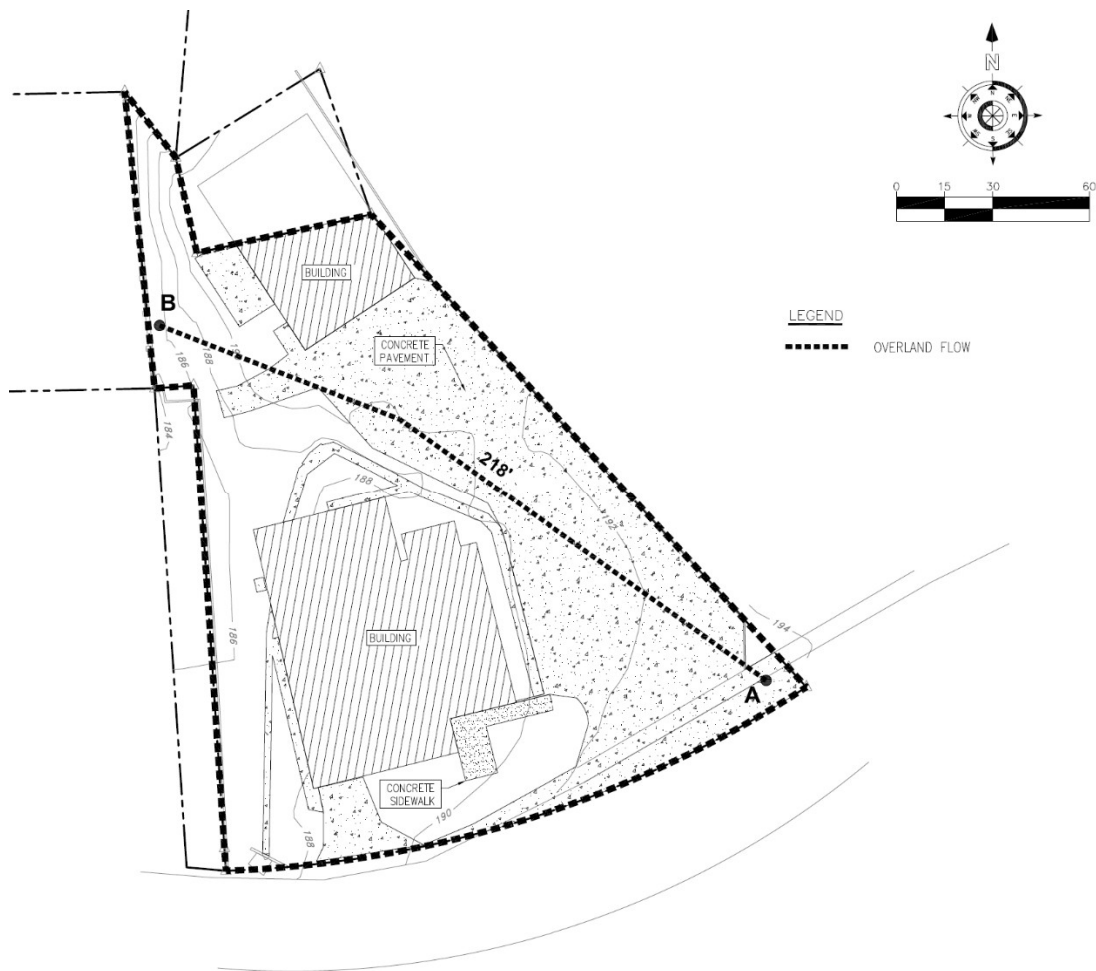

The flow pattern will be evaluated to determine the Time of Concentration (T_c) which will be used to determine the stormwater water runoff volume.

$P_{24} =$ 4 IN (2yr_24 HOUR CUMMULATIVE RAINFALL AMOUNT)

$$T_t = \frac{(.007)(nL)^{.8}}{(F)^{.5}(S)^{.4}}$$

(OVERLAND FLOW)


TABLE 3 - PRE-DEVELOPMENT TIME OF CONCENTRATION T_c (2yr - 24 HOUR STORM)				
SEGMENT DESCRIPTION	SLOPE (S)	LENGTH (L)	MANNING'S COEF. (n)	T_t (hrs)
A-B (OVERLAND FLOW)	0.078	218	0.03	0.044

$T_c = \sum T_t =$ 0.044 hrs (2YR - 24HR STORM) (USE MIN. 0.08 HRS)

➤ POST-DEVELOPMENT

In the post-development, the site has one distinct flow path, which is a combination of overland and pipe flow as follows:

- A-B (Overland Flow) – 30 ft. travel distance @ average slope of 2.0%
- B-C (Pipe Flow) – 98 ft. travel distance @ average slope of 0.5%
- C-D (Pipe Flow) – 52 ft. travel distance @ average slope of 0.5%
- D-E (Pipe Flow) – 40 ft. travel distance @ average slope of 0.5%

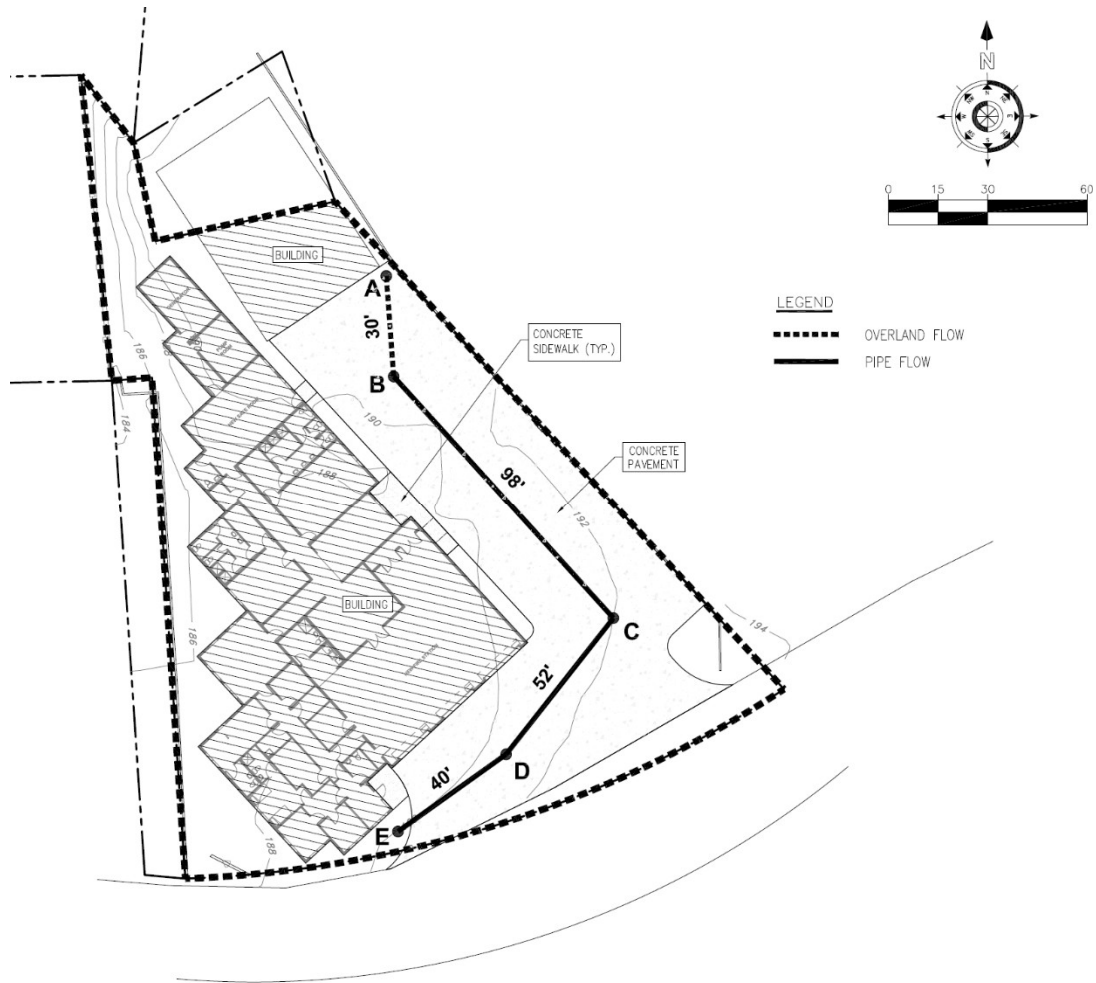

The flow pattern will be evaluated to determine the Time of Concentration (T_c) which will be used to determine the stormwater water runoff volume.

$P_{24} =$ 4 IN (2yr_24 HOUR CUMMULATIVE RAINFALL AMOUNT)

$$T_t = \frac{(.007) (nL)^{.8}}{(P)^{.5} (S)^{.4}} \quad \text{(OVERLAND FLOW)}$$

$$T_t = \frac{L}{v} \quad \text{(PIPE FLOW)}$$

$$v = \frac{1.49}{n} (D/4)^{2/3} S^{1/2} \quad \text{(PIPE VELOCITY)}$$

TABLE 4 - POST-DEVELOPMENT TIME OF CONCENTRATION T _c (2yr - 24 HOUR STORM)								
SEGMENT DESCRIPTION		SLOPE (S)	LENGTH (L)	PIPE DIA (FT.)	PIPE VELOCITY (FT./S)	MANNING'S COEF. (n)	Individual T _t (hrs)	Cummulative T _t (hrs)
A-B-C-D-E (OVERLAND & PIPE FLOW)	A-B (OVERLAND)	0.05	30	N/A	N/A	0.03	0.011	0.026
	B-C (PIPE)	0.005	98	1.33	3.37	0.015	0.008	
	C-D (PIPE)	0.005	52	1.33	3.37	0.015	0.004	
	D-E (PIPE)	0.005	40	1.33	3.37	0.015	0.003	

$T_c = \sum T_t =$ 0.026 hrs (2YR - 24HR STORM) (USE MIN. 0.08 HRS)

RUNOFF (Q) AND STORAGE VOLUME (V)

DPNR Runoff Onsite Storage Requirements as per the ***Territorial Pollutant Discharge Elimination System - General Permit Number VIGSA0000*** is as follows:

- 1) 3600 cubic feet per acre (1" over 1 acre) or,
- 2) 2yr – 24 hours storm; whichever is greater

➤ PRE-DEVELOPMENT

PRE-DEVELOPMENT - RUNOFF (Q) AND TOTAL VOLUME (V)

Runoff equation

$$Q = \frac{\left[P - 0.2 \left(\frac{1000}{CN} - 10 \right) \right]^2}{P + 0.8 \left(\frac{1000}{CN} - 10 \right)}$$

where:

Q = runoff (in)

P = rainfall (in)

CN = runoff curve number

Volume Equation

$$V = QA$$

where:

Q = runoff (ft)

A = Area (ac)

DPNR Runoff Onsite Storage Requirements

(Territorial Pollutant Discharge Elimination System - General Permit Number VIGSA0000)

1) 3600 cubic feet per acre (1" over 1 acre), or

2) 2 yr - 24 hour storm; whichever is greater

1) 3600 CUBIC FEET PER ACRE

Disturbed Site Acreage = 0.59 ac

$$V = \boxed{0.05} \text{ ac-ft}$$

2) 2 YR - 24 HOUR STORM

STORM EVENT	P (in)	CN	Q (in)	Area (ac)	V (ac-ft)
2 - YEAR	4	95	3.43	0.59	0.17

As can be noted from the above calculations, the 2yr – 24 hr. storm event generates the most runoff in the pre-development/ current site condition.

➤ POST-DEVELOPMENT

POST-DEVELOPMENT - RUNOFF (Q) AND TOTAL VOLUME (V)

Runoff equation

$$Q = \frac{\left[P - 0.2 \left(\frac{1000}{CN} - 10 \right) \right]^2}{P + 0.8 \left(\frac{1000}{CN} - 10 \right)}$$

where:

Q = runoff (in)

P = rainfall (in)

CN = runoff curve number

Volume Equation

$$V = QA$$

where:

Q = runoff (ft)

A = Area (ac)

DPNR Runoff Onsite Storage Requirements

(Territorial Pollutant Discharge Elimination System - General Permit Number VIGSA0000)

1) 3600 cubic feet per acre (1" over 1 acre), or

2) 2 yr - 24 hour storm; whichever is greater

1) 3600 CUBIC FEET PER ACRE

Disturbed Site Acreage = 0.59 ac

$$V = \boxed{0.05} \text{ ac-ft}$$

2) 2 YR - 24 HOUR STORM


STORM EVENT	P (in)	CN	Q (in)	Area (ac)	V (ac-ft)
2 - YEAR	4	96	3.54	0.59	0.17

As can be noted from the above calculations, the 2yr – 24 hr. storm event generates the most runoff in the post-development.


CONCLUSION

The proposed improvements do not result in any adverse impacts over the existing condition which is evident in the pre vs. post runoff coefficient, having a negligible increase from 95 to 96. Pre vs. Post runoff equates to zero net increase (0.06 ac-ft – 0.06 ac-ft).

1-inch of runoff over the entire disturbed site equates to **0.05 ac-ft**. Even though the site is less than 1-acre and per V.I. Code, the provision of onsite storage is not a requirement, the site layout does facilitate the installation of underground storage chambers to accommodate the 1-inch runoff volume.

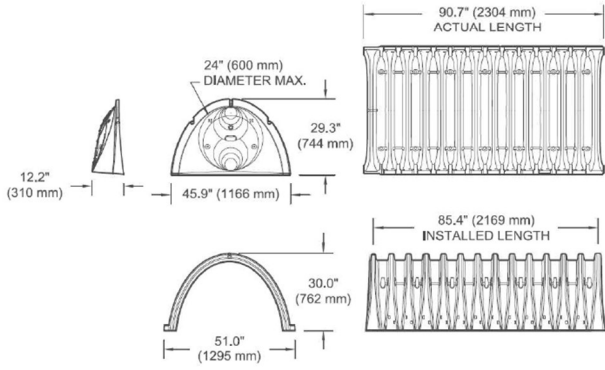StormTech Underground Storage Chambers Calculations					
Required Storage =			0.05	ac-ft	
System Invert Elevation =			185.20	ft	
System Top Elevation =			188.70	ft	
Depth of Water in System =			3.50	ft	
Storage Volume Per Chamber =			81.7	ft ³	
			0.0019	ac-ft	
No. of Required Chambers =			27.00	each	
No. of Chambers Provided =			30.00	each	OK!
Length of Required Chambers			205.00	linear feet	
Length of Chambers Provided			227.00	linear feet	OK!
Chamber Dimensions					
					

APPENDICES

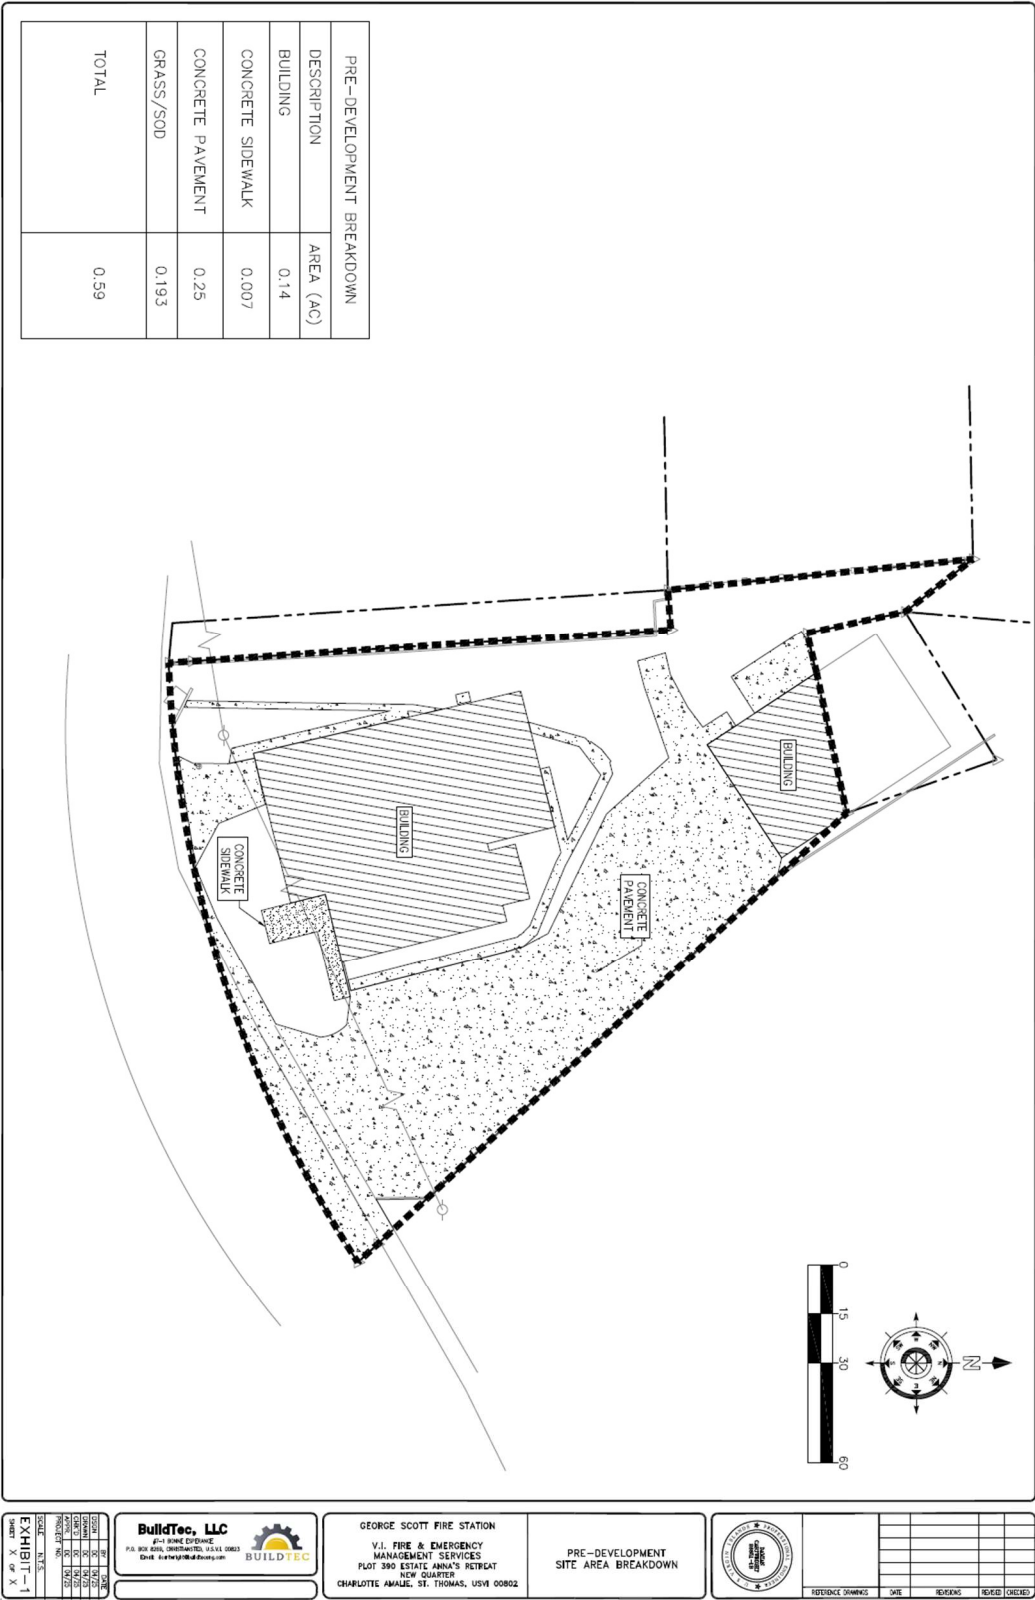

PRE-DEVELOPMENT SITE AREA BREAKDOWN

