

HYDROLOGY STUDY REPORT

PROJECT SITE:

**V.I. FIRE & EMERGENCY MEDICAL SERVICES (VIFEMS)
REM. EST. CONTANT & ENIGHED CRUZ BAY QTR
CRUZ BAY, ST. JOHN, USVI 00801**



PREPARED BY:


BUILDTec
7-1 BONNE ESPERANCE
P.O. BOX 8269
CHRISTIANSTED, ST. CROIX USVI 00823

TABLE OF CONTENTS

| | |
|---|----|
| INTRODUCTION | 3 |
| SOILS CLASSIFICATION | 3 |
| CURVE NUMBER (CN) CLASSIFICATION..... | 4 |
| BASIN CHARACTERISTICS | 6 |
| TIME OF CONCENTRATION (T_c) | 7 |
| RUNOFF (Q) AND STORAGE VOLUME (V) | 9 |
| CONCLUSION..... | 11 |
| APPENDICES | 13 |

INTRODUCTION

This site was previously developed and has a considerable amount of development that currently exist. The proposed improvements primarily encompass the replacement of the existing 3,000 square feet antiquated fire station building with a new expanded state-of-the-art facility measuring approximately 9,825 gross square footage distributed across three (3) floors. The new facility will be constructed within the exact same footprint of the existing facility.

The disturbed area is only 0.20 acres which is significantly less than the 1-acre mandated threshold for a required hydrology study. Nonetheless, a hydrology study has been undertaken to ascertain the impacts of the proposed improvements. This hydrology study will focus on a pre-development vs. a post-development analysis.

SOILS CLASSIFICATION


For Curve Number (CN) determination, there are four (4) main types of Hydrologic Soils Classification which are as follows:

Group A – Soils that have low runoff potential when thoroughly wet. These soils typically have less than 10% clays and more than 90% sand or gravel.

Group B – Soils that have moderately low runoff potential when thoroughly wet. These soils typically have between 10% - 20% clays and 50% - 90% sand.

Group C – Soils that have moderately high runoff potential when thoroughly wet. These soils typically have between 20% - 40% clays and less than 50% sand.

Group D – Soils that have high runoff potential when thoroughly wet. These soils typically have greater than 40% clays and less than 50% sand.

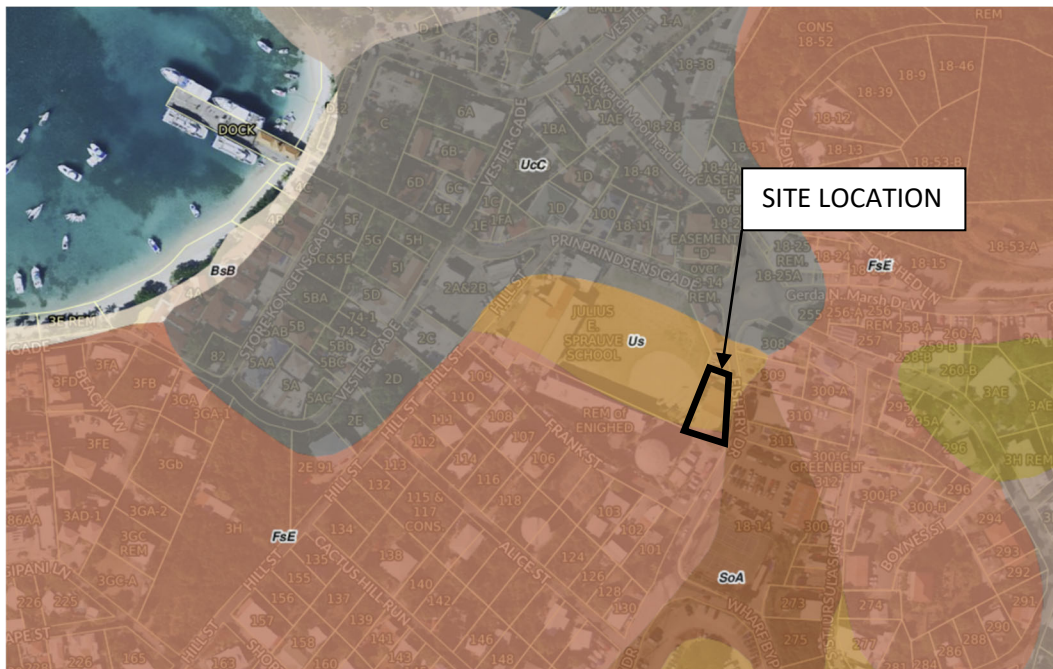

St. Croix Hydrologic Soils Classification (Source: <https://usvi.mapgeo.io>)

Based on the above, the Hydrologic Soils Classification for the Site is **Group D**. This soil classification type is synonymous with Group D in Table 3.6 below.

CURVE NUMBER (CN) CLASSIFICATION

The curve number classification is determined based on land use type and hydrologic soil type. The table below indicates CN values for various land uses and hydrologic soil types.

Table 3-6. Typical Curve Number Values for Urban Areas (SCS 1986)

| Cover description | | Curve numbers for hydrologic soil group | | | |
|--|--|---|----|----|----|
| Cover type and hydrologic condition | Average percent impervious area ^{1/2} | A | B | C | D |
| <i>Fully developed urban areas (vegetation established)</i> | | | | | |
| <i>Open space (lawns, parks, golf courses, cemeteries, etc.) ^{3/4}</i> | | | | | |
| Poor condition (grass cover < 50%) | | 68 | 79 | 86 | 89 |
| Fair condition (grass cover 50% to 75%) | | 49 | 69 | 79 | 84 |
| Good condition (grass cover > 75%) | | 39 | 61 | 74 | 80 |
| <i>Impervious areas:</i> | | | | | |
| Paved parking lots, roofs, driveways, etc. (excluding right-of-way) | | 98 | 98 | 98 | 98 |
| <i>Streets and roads:</i> | | | | | |
| Paved; curbs and storm sewers (excluding right-of-way) | | 98 | 98 | 98 | 98 |
| Paved; open ditches (including right-of-way) | | 83 | 89 | 92 | 93 |
| Gravel (including right-of-way) | | 76 | 85 | 89 | 91 |
| Dirt (including right-of-way) | | 72 | 82 | 87 | 89 |
| <i>Western desert urban areas:</i> | | | | | |
| Natural desert landscaping (pervious areas only) ^{4/5} | | 63 | 77 | 85 | 88 |
| Artificial desert landscaping (impervious weed barrier, desert shrub with 1- to 2-inch sand or gravel mulch and basin borders) | | 96 | 96 | 96 | 96 |
| <i>Urban districts:</i> | | | | | |
| Commercial and business | 85 | 89 | 92 | 94 | 95 |
| Industrial | 72 | 81 | 88 | 91 | 93 |
| <i>Residential districts by average lot size:</i> | | | | | |
| 1/8 acre or less (town houses) | 65 | 77 | 85 | 90 | 92 |
| 1/4 acre | 38 | 61 | 75 | 83 | 87 |
| 1/3 acre | 30 | 57 | 72 | 81 | 86 |
| 1/2 acre | 25 | 54 | 70 | 80 | 85 |
| 1 acre | 20 | 51 | 68 | 79 | 84 |
| 2 acres | 12 | 46 | 65 | 77 | 82 |
| <i>Developing urban areas</i> | | | | | |
| <i>Newly graded areas (pervious areas only, no vegetation) ^{5/6}</i> | | | | | |
| | | 77 | 86 | 91 | 94 |
| <i>Idle lands (CN's are determined using cover types similar to those in table 2-2c).</i> | | | | | |

¹ Average runoff condition, and $I_a = 0.28$.

² The average percent impervious area shown was used to develop the composite CN's. Other assumptions are as follows: impervious areas are directly connected to the drainage system, impervious areas have a CN of 98, and pervious areas are considered equivalent to open space in good hydrologic condition. CN's for other combinations of conditions may be computed using figure 2-3 or 2-4.

³ CN's shown are equivalent to those of pasture. Composite CN's may be computed for other combinations of open space cover type.

⁴ Composite CN's for natural desert landscaping should be computed using figures 2-3 or 2-4 based on the impervious area percentage (CN = 96) and the pervious area CN. The pervious area CN's are assumed equivalent to desert shrub in poor hydrologic condition.

⁵ Composite CN's to use for the design of temporary measures during grading and construction should be computed using figure 2-3 or 2-4 based on the degree of development (impervious area percentage) and the CN's for the newly graded pervious areas.

Based on the above, the site falls into two (2) distinct classifications listed as follows:

Poor condition (grass cover < 50%) – this accounts for the grass cover within the property.

Paved parking lots, roofs and driveways, etc. (excluding right-of-way) – this accounts for the paved surfaces and buildings within the property.

BASIN CHARACTERISTICS

The disturbed area of the site is approximately 0.20 acres broken down into two (2) major ground cover types. The table below shows the breakdown along with a Weighted Curve Number for each category and ultimately for the entire site.

➤ PRE-DEVELOPMENT

| TABLE 1 - PRE-DEVELOPMENT BASIN CHARACTERISTICS | | | |
|---|------|-------|----------------------------|
| DESCRIPTION | AREA | UNITS | WEIGHTED CURVE NUMBER (CN) |
| BUILDINGS | 0.07 | AC | 98 |
| SIDEWALK | 0 | AC | 98 |
| GRASS COVER | 0.09 | AC | 89 |
| CONCRETE PAVEMENT | 0.04 | AC | 98 |

| | | |
|------------|------|----|
| TOTAL AREA | 0.20 | AC |
|------------|------|----|

| | |
|-------------------|----|
| WEIGHTED CN VALUE | 94 |
|-------------------|----|

➤ POST-DEVELOPMENT

| TABLE 2 - POST-DEVELOPMENT BASIN CHARACTERISTICS | | | |
|--|-------|-------|----------------------------|
| DESCRIPTION | AREA | UNITS | WEIGHTED CURVE NUMBER (CN) |
| BUILDINGS | 0.10 | AC | 98 |
| SIDEWALK | 0.015 | AC | 98 |
| CONCRETE PAVEMENT | 0.04 | AC | 98 |
| GRASS COVER | 0.04 | AC | 89 |

| | | |
|------------|------|----|
| TOTAL AREA | 0.20 | AC |
|------------|------|----|

| | |
|-------------------|----|
| WEIGHTED CN VALUE | 96 |
|-------------------|----|


TIME OF CONCENTRATION (T_c)

The time of concentration is necessary to estimate peak discharge and is dependent upon the watershed characteristics. To accurately determine T_c , the hydraulics of each part of the flow path must be considered separately.

➤ PRE-DEVELOPMENT

In the pre-development, the site has one distinct flow path, which is overland flow as follows:

- A-B (Overland Flow) – 182 ft. travel distance @ average slope of 7.7%

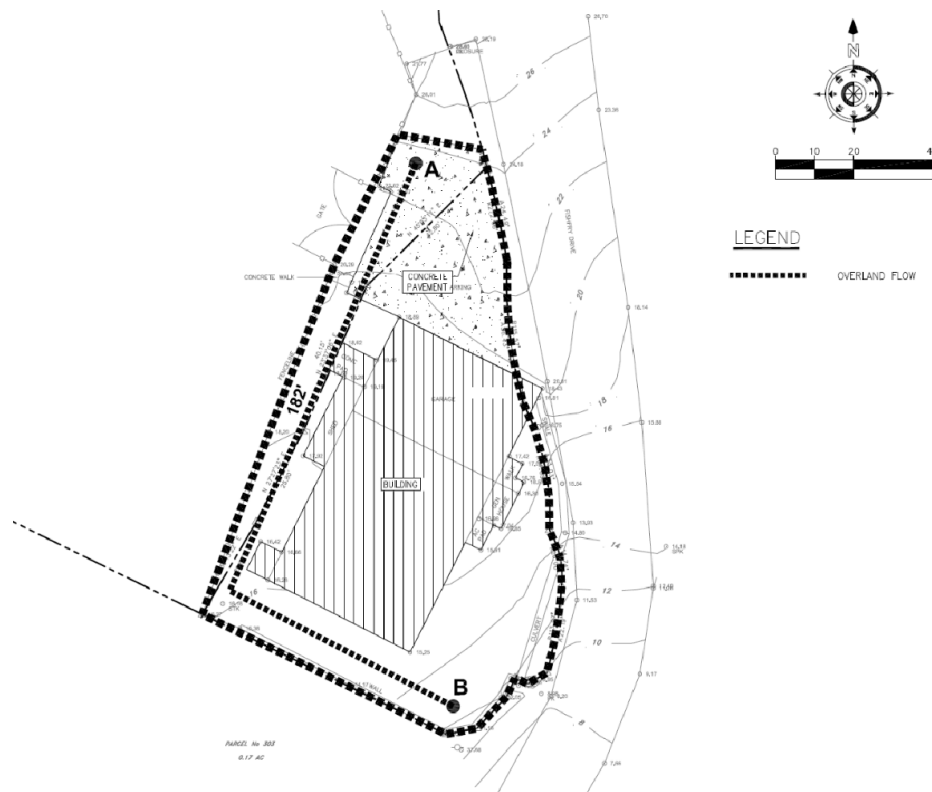

The flow pattern will be evaluated to determine the Time of Concentration (T_c) which will be used to determine the stormwater water runoff volume.

$P_{24} =$ 4 IN (2yr_24 HOUR CUMMULATIVE RAINFALL AMOUNT)

$$T_t = \frac{(.007) (nL)^{.8}}{(P)^{.5} (S)^{.4}}$$

(OVERLAND FLOW)


| TABLE 3 - PRE-DEVELOPMENT TIME OF CONCENTRATION T_c (2yr - 24 HOUR STORM) | | | | |
|---|-----------|------------|---------------------|-------------|
| SEGMENT DESCRIPTION | SLOPE (S) | LENGTH (L) | MANNING'S COEF. (n) | T_t (hrs) |
| A-B (OVERLAND FLOW) | 0.077 | 182 | 0.03 | 0.038 |

$T_c = \sum T_t =$ 0.038 hrs (2YR - 24HR STORM) (USE MIN. 0.08 HRS)

➤ POST-DEVELOPMENT

In the post-development, the site has one distinct flow path, which is overland flow as follows:

- A-B (Overland Flow) – 189 ft. travel distance @ average slope of 7.40%

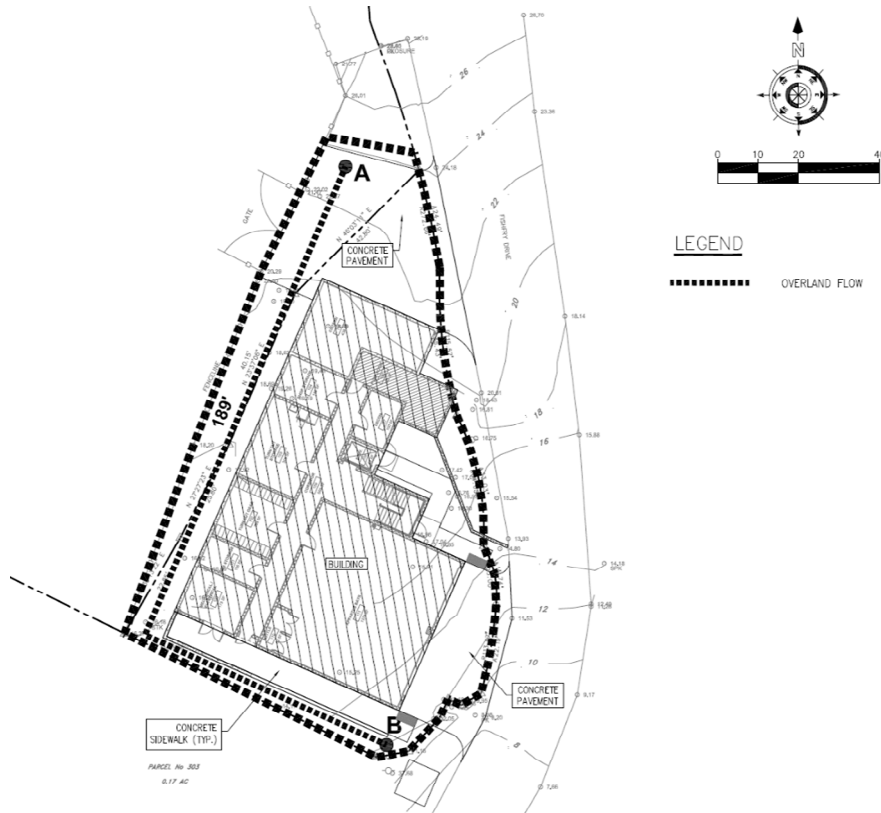

The flow pattern will be evaluated to determine the Time of Concentration (Tc) which will be used to determine the stormwater water runoff volume.

P₂₄ = 4 IN (2yr_24 HOUR CUMMULATIVE RAINFALL AMOUNT)

$$T_t = \frac{(.007)(nL)^{.8}}{(F)^{.5}(S)^{.4}}$$

(OVERLAND FLOW)

$$T_t = \frac{L}{v}$$

(PIPE FLOW)

$$v = \frac{1.49}{n} (D/4)^{2/3} S^{1/2}$$

(PIPE VELOCITY)

| TABLE 4 - POST-DEVELOPMENT TIME OF CONCENTRATION Tc (2yr - 24 HOUR STORM) | | | | |
|---|-----------|------------|--------------------|----------|
| SEGMENT DESCRIPTION | SLOPE (S) | LENGTH (L) | ANNING'S COEF. (n) | Tt (hrs) |
| A-B (OVERLAND FLOW) | 0.074 | 189 | 0.03 | 0.040 |

Tc = ΣTt = 0.040 hrs (2YR - 24HR STORM) (USE MIN. 0.08 HRS)

RUNOFF (Q) AND STORAGE VOLUME (V)

DPNR Runoff Onsite Storage Requirements as per the ***Territorial Pollutant Discharge Elimination System - General Permit Number VIGSA0000*** is as follows:

- 1) 3600 cubic feet per acre (1" over 1 acre) or,
- 2) 2yr – 24 hours storm; whichever is greater

➤ PRE-DEVELOPMENT

PRE-DEVELOPMENT - RUNOFF (Q) AND TOTAL VOLUME (V)

Runoff equation

$$Q = \frac{\left[P - 0.2 \left(\frac{1000}{CN} - 10 \right) \right]^2}{P + 0.8 \left(\frac{1000}{CN} - 10 \right)}$$

where:

Q = runoff (in)

P = rainfall (in)

CN = runoff curve number

Volume Equation

$$V = QA$$

where:

Q = runoff (ft)

A = Area (ac)

DPNR Runoff Onsite Storage Requirements

(Territorial Pollutant Discharge Elimination System - General Permit Number VIGSA0000)

1) 3600 cubic feet per acre (1" over 1 acre), or

2) 2 yr - 24 hour storm; whichever is greater

1) 3600 CUBIC FEET PER ACRE

Disturbed Site Acreage = 0.20 ac

$$V = \boxed{0.02} \text{ ac-ft}$$

2) 2 YR - 24 HOUR STORM

| STORM EVENT | P (in) | CN | Q (in) | Area (ac) | V (ac-ft) |
|-------------|--------|----|--------|-----------|-----------|
| 2 - YEAR | 4 | 94 | 3.32 | 0.20 | 0.06 |

As can be noted from the above calculations, the 2yr – 24 hr. storm event generates the most runoff in the pre-development/ current site condition.

➤ POST-DEVELOPMENT

POST-DEVELOPMENT - RUNOFF (Q) AND TOTAL VOLUME (V)

Runoff equation

$$Q = \frac{\left[P - 0.2 \left(\frac{1000}{CN} - 10 \right) \right]^2}{P + 0.8 \left(\frac{1000}{CN} - 10 \right)}$$

where:

Q = runoff (in)

P = rainfall (in)

CN = runoff curve number

Volume Equation

$$V = QA$$

where:

Q = runoff (ft)

A = Area (ac)

DPNR Runoff Onsite Storage Requirements

(Territorial Pollutant Discharge Elimination System - General Permit Number VIGSA0000)

1) 3600 cubic feet per acre (1" over 1 acre), or

2) 2 yr - 24 hour storm; whichever is greater

1) 3600 CUBIC FEET PER ACRE

Disturbed Site Acreage = 0.20 ac

$$V = \boxed{0.02} \text{ ac-ft}$$

2) 2 YR - 24 HOUR STORM

| STORM EVENT | P (in) | CN | Q (in) | Area (ac) | V (ac-ft) |
|-------------|--------|----|--------|-----------|-----------|
| 2 - YEAR | 4 | 96 | 3.54 | 0.20 | 0.06 |

As can be noted from the above calculations, the 2yr – 24 hr. storm event generates the most runoff in the post-development.

CONCLUSION

The proposed improvements do not result in any adverse impacts over the existing condition which is evident in the pre vs. post runoff coefficient, having a negligible increase from 94 to 96. Pre vs. Post runoff equates to zero net increase (0.06 ac-ft – 0.06 ac-ft).

1-inch of runoff over the entire disturbed site equates to **0.02 ac-ft**. Unfortunately, given site constraints, it's not possible to accommodate any onsite storage. However, it must be noted that the site is less than 1-acre, so per V.I. Code, the provision of onsite storage is not a requirement. In lieu of onsite storage, the

proposed improvements do include a cistern which has a capacity of 35,800 gallons or **0.11 ac-ft**. This is more than five times the storage required for 1-inch of runoff from the site and thus will help to mitigate site runoff; however, there is no guarantee what available storage will exist in the cistern at the onset of each rainfall event.

13 | Page



